


ALPHA CHEMICAL LIMITED  
 533 ROCKY LAKE DRIVE  
 WAVERLEY, NOVA SCOTIA

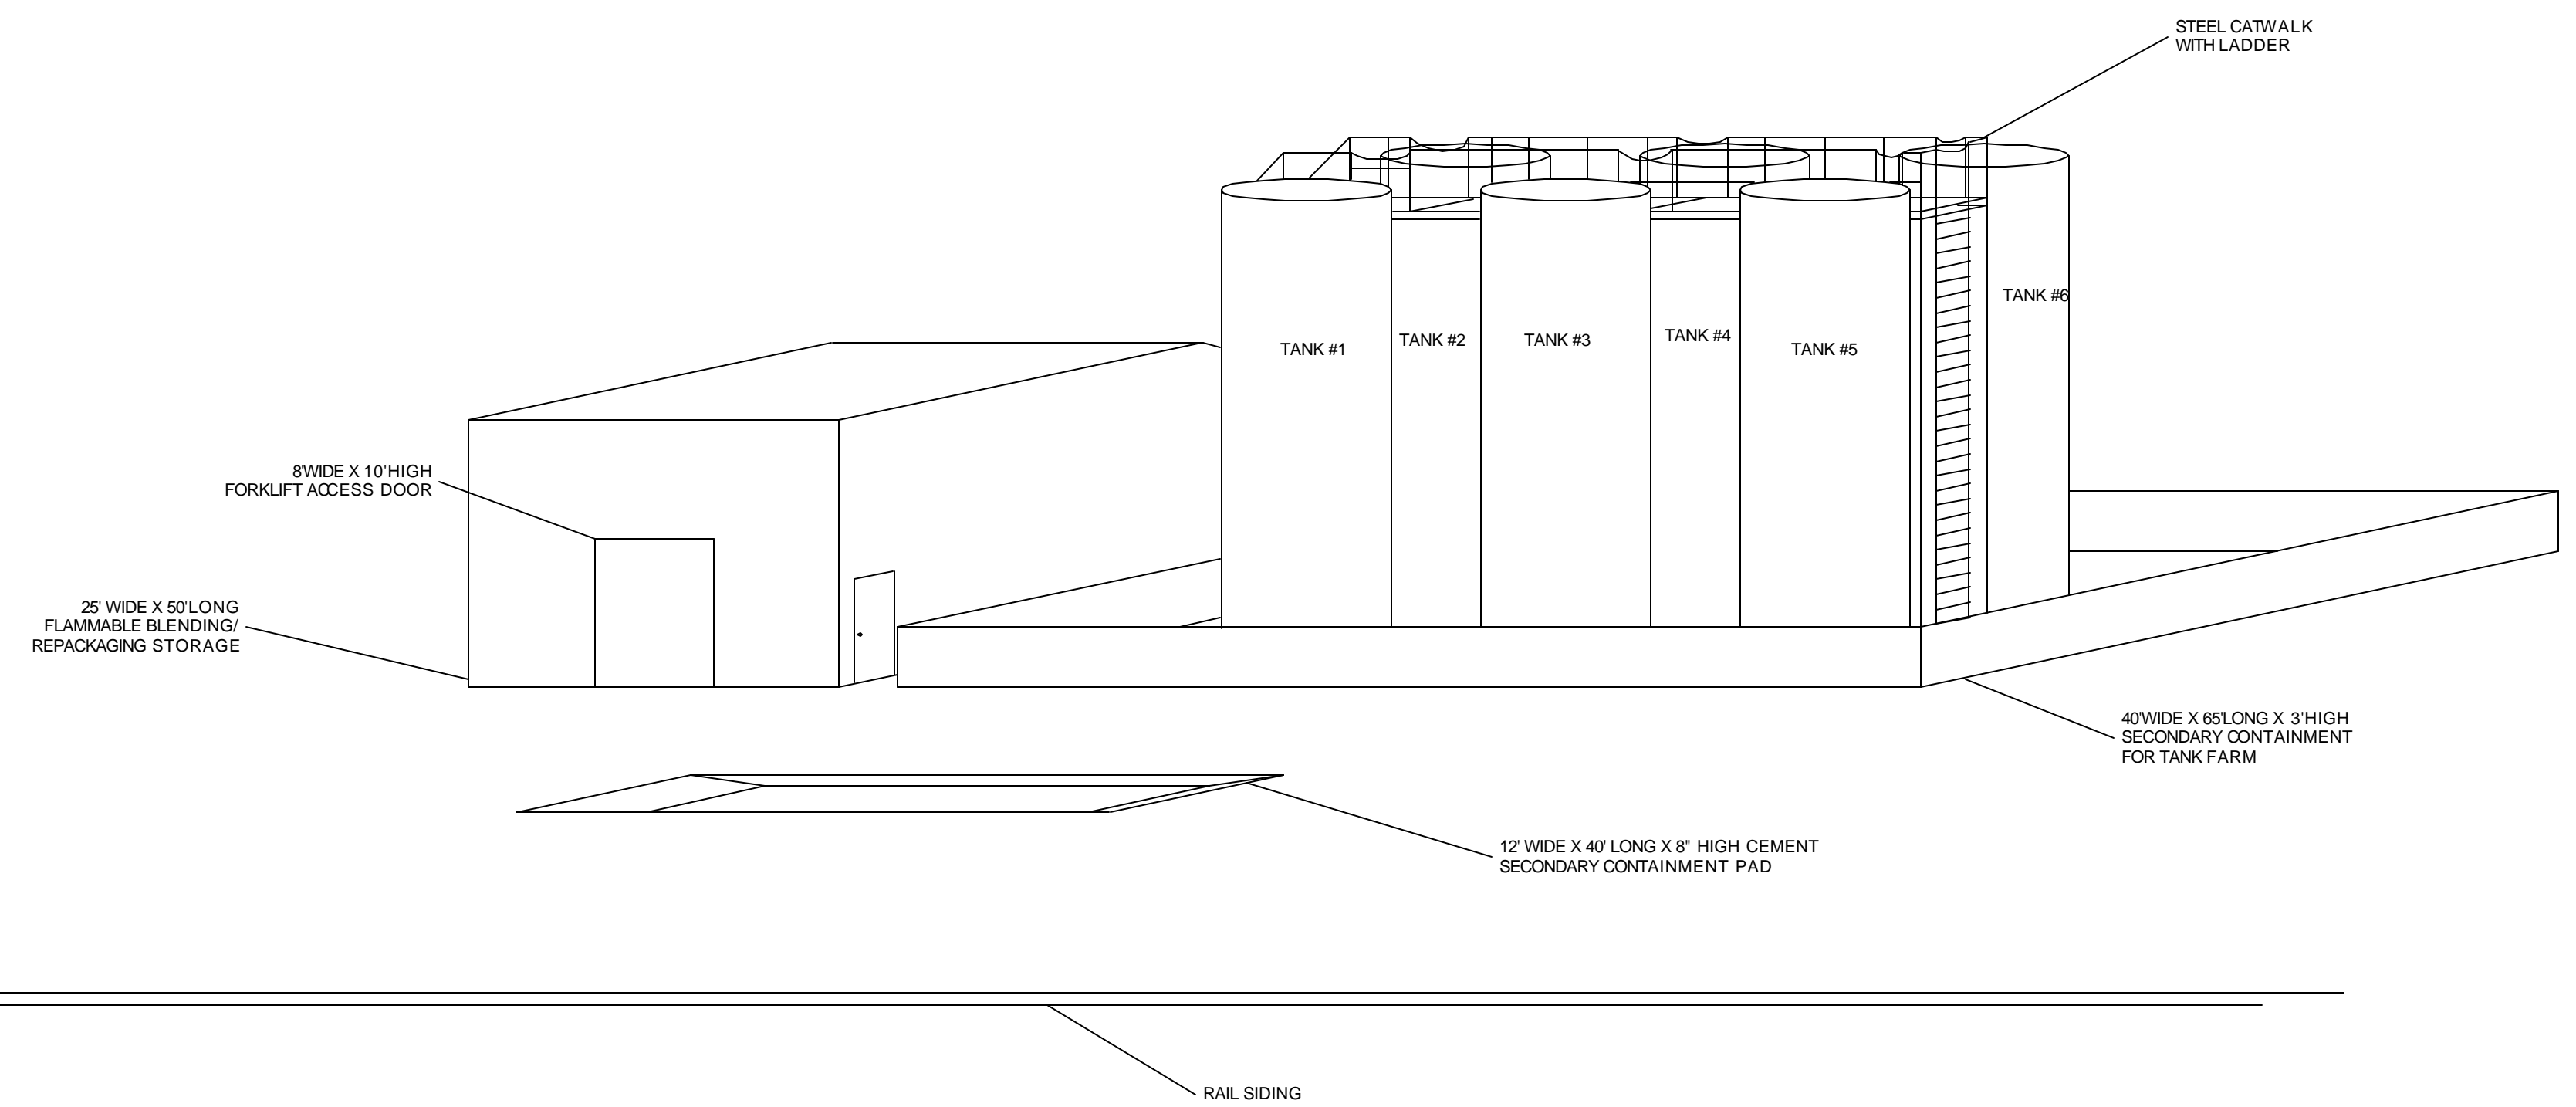

- NOTES:
1. BUILDING DIMENSIONS - 25' WIDE X 20' HIGH X 50' LONG. WITH 8" HIGH CEMENT FOUNDATION FOOTING FOR SECONDARY CONTAINMENT.
  2. TRUCK LOADING/ OFFLOADING PAD DIMENSIONS - 12' WIDE X 40' LONG X 8" HIGH.
  3. NATIONAL BUILDING CODE IS F1 - HIGH HAZARD INDUSTRIAL OCCUPANCY.
  4. MINIMUM FIRE-RESISTANCE RATING - 2 HOURS. (SEE PART 4.2.7.3 IN THE NATIONAL FIRE CODE)
  5. NATIONAL FIRE CODE CLASSIFICATION - CLASS 1B FLAMMABLE LIQUIDS HAVING A FLASH POINT BELOW 22.8° C AND A BOILING POINT AT OR ABOVE 37.8° C.
  6. ELECTRICAL TO MEET CSA C22.1 - CANADIAN ELECTRICAL CODE PART 1. ELECTRICAL INSTALLATION MUST BE EXPLOSION PROOF.
  7. SPILL CONTROL MUST MEET PART 4.1.6 I THE NATIONAL FIRE CODE.
  8. DRAINAGE SYSTEMS MUST MEET PART 4.1.6.2 IN THE NATIONAL FIRE CODE.
  9. FIRE SUPPRESSION SYSTEM TO MEET PART 6 OF THE NATIONAL FIRE CODE.

SCALE - 1" = 10'

ALPHA CHEMICAL LIMITED
DRAWING: BLENDING BUILDING PROJECT: WAVERLEY PLANT REVISION: JULY 20, 2004 BY: P. RAWDING